



MIHW-200-160CH-B Constant Temperature Chamber

(With Integrated Battery Testing System)

Technical Agreement

Neware Technology Limited

Contact: jade@newarebattery.com


Product Name:


Constant Temperature Chamber
(With Integrated Battery Testing System)

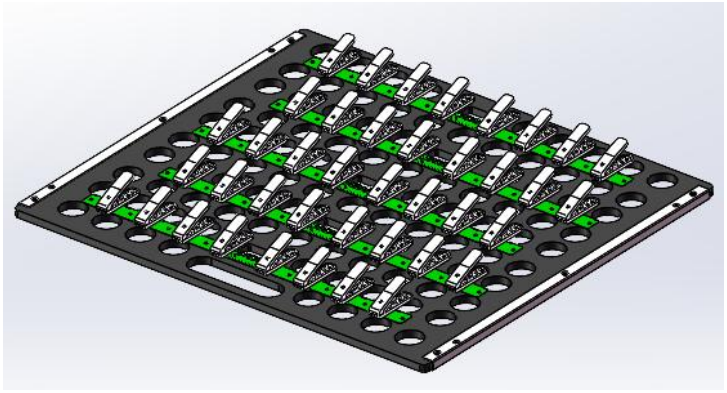
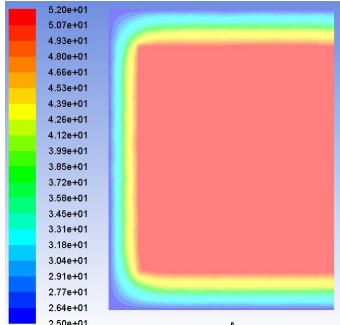


P.S. Image is for reference purpose only.

| | |
|---------------------|--|
| Model Code | MIHW-200-160CH-B |
| Application | Constant temperature tests of battery cells |
| Prohibitions | Testing or storage of : - flammable, explosive and volatile material samples; - corrosive substances; - strong electromagnetic emission source; - radioactive material samples; - highly toxic substances; - samples that may produce the above substances or objects during testing or storage. |
| Dimensions | |
| Nominal Volume | 200L |
| Inner Dimension | W500 mm×D500 mm×H800 mm |
| Outer Dimension | W600 mm×D920 mm×H1800 mm |
| Net Weight | Around 200kg |
| Performance | |
| Testing Environment | Operating Room Temperature: above 25℃ Relative humidity: ≤85% |
| Temperate Range | 0~60℃ |
| Fluctuation | ≤1℃ (No load, or during stable temperature) |
| Deviation | ±2.0℃ (No load, or during stable temperature) |
| Heating Time | 25℃→60℃ ≤30 min (no load, average non-linearity) |
| Cooling Time | 25℃→0℃ ≤50 min (no load, average non-linearity) |

| Structure | |
|----------------------------------|---|
| Insulation Envelope | <ul style="list-style-type: none"> - Outer wall material: High quality cold rolled steel plate with surface spray paints. - Inner wall material: Stainless Steel SUS304 - Insulation material: Polyurethane foam |
| Air-conditioning Channel | Axial Fan, heater, evaporator |
| Standard Configuration | <ul style="list-style-type: none"> - Door: insulated tempered glass + Frames - 4 Lead holes (with soft rubber stopper): $\phi 50\text{mm}$ - 4 casters; - Cell Trays: electrically insulated (load bearing: 10kg/tray); - LED illuminating light. |
| Control Panel | Control buttons |
| Heater | Stainless steel heating tube Non-contact equal-period pulse width modulation, SSR |
| Cooling System | |
| Refrigeration Compressors | Hermetic Piston Compressor  |
| Cooling Method | Air-cooled |
| Throttling Device | Capillary |
| Refrigerant | R134a |
| Welding Process | Nitrogen protected welding |
| Electrical Control System | |
| Controller | LED digital display + button controller |
| Setting Method | Button controller |
| Control Method | Forced circulation ventilation. The system controls the output of the semiconductor refrigeration/heating module through the PID results, in order to achieve a dynamic balance. |
| Communication | Ethernet |
| Temperature Control Module | Independent R&D (passed relevant reliability performance tests such as high and low temperature shock tests, vibration tests, EMC tests etc.) |

| Health and Safety Protection | |
|-------------------------------------|---|
| Test Chamber | <ul style="list-style-type: none"> - Leakage Protection - Short circuit protection - Operating protection of circulating fan |
| Other Configuration | |
| Power Cable | 1 core (Single phase + protective ground wire) |
| Leakage Circuit Breaker | Single phase + protective ground wire |
| Conditions of Use | |
| Installation Site | <ul style="list-style-type: none"> - Level ground, comply with GB50209-2002 Specification. - Flatness $\leq 5\text{mm}/2\text{m}$ - Good ventilation - No strong vibration around the device - No strong electromagnetic fields around the device - No flammable/explosive/corrosive substances & dust around the device. - Appropriate space for use and maintenance should be reserved around the equipment: A: not less than 100cm B: not less than 60cm C: not less than 70cm D: not less than 50cm <p>There should be enough room for the door to be opened and closed normally, and there should be no other objects directly in front of the door of the equipment.</p>  |
| Environmental Conditions | Temperature: $5^{\circ}\text{C} \sim 35^{\circ}\text{C}$ Relative humidity: $\leq 85\%$; Atmospheric pressure: $86\text{kPa} \sim 106\text{kPa}$ |
| Power Supply Condition | Input: $\text{AC}(220 \pm 22)\text{V}$ (50 ± 0.5)Hz single phase + protective ground wire. The grounding resistance of the protective ground wire is less than 4Ω . The user is required to configure an independent air or power switch of the corresponding capacity for the equipment at the installation site. |
| Distribution Power | 3kW (The device power will vary depends on the configuration of the battery testing system) |
| Maximum Current | 16A (The device current will vary depends on the configuration of the battery testing system) |
| Precautions | Opening the door while testing will cause temperature fluctuations. During the test, if the door is opened many times or the door is left open for a long time or the test sample emits moisture, it may cause the heat exchanger of the refrigeration system to frost or freeze and cannot work properly. |

| Battery Specifications and Placement | |
|---|--|
| Cell Specification | Coin cells |
| Cell Placement | - Maximum 40 channels on each tray - 4 trays in total |
| Battery Trays (customization available) |  |
| Simulation Diagram (reference only) | |
| No-Load Operation |  |